



CONTROL ROOM

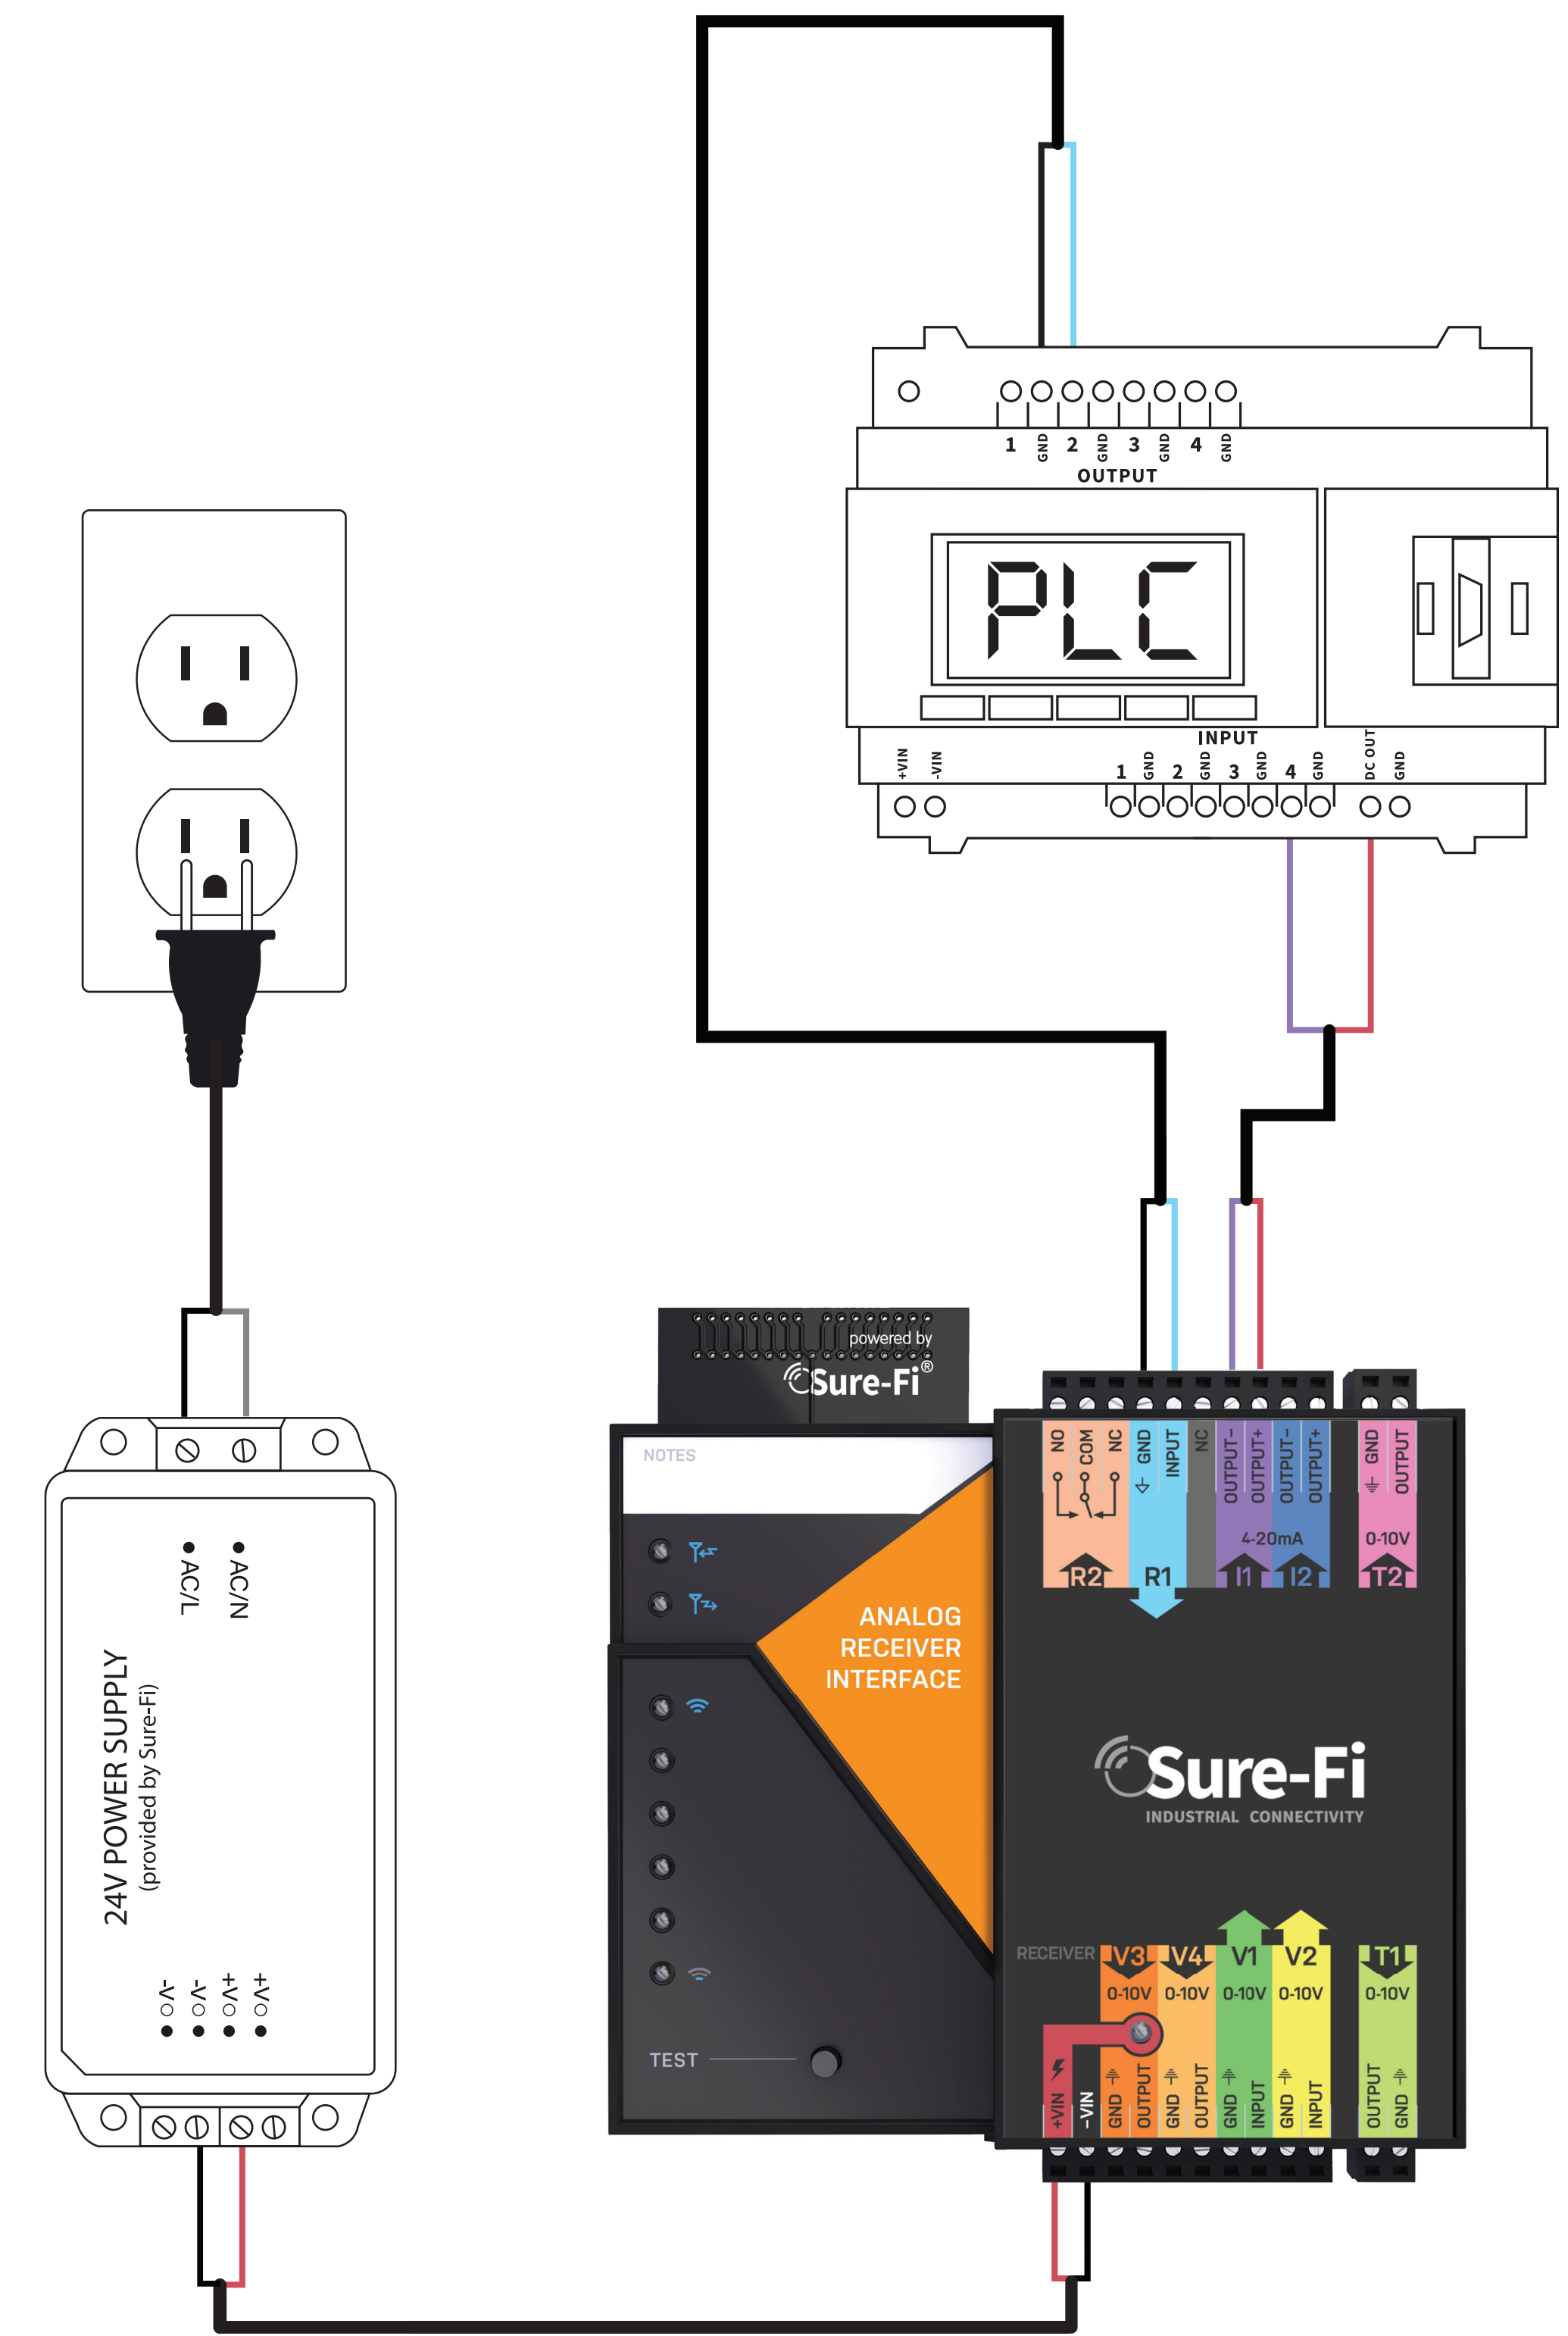


WIRING EXAMPLE FOR PRESSURE TRANSDUCER IN MANUFACTURING SETTING

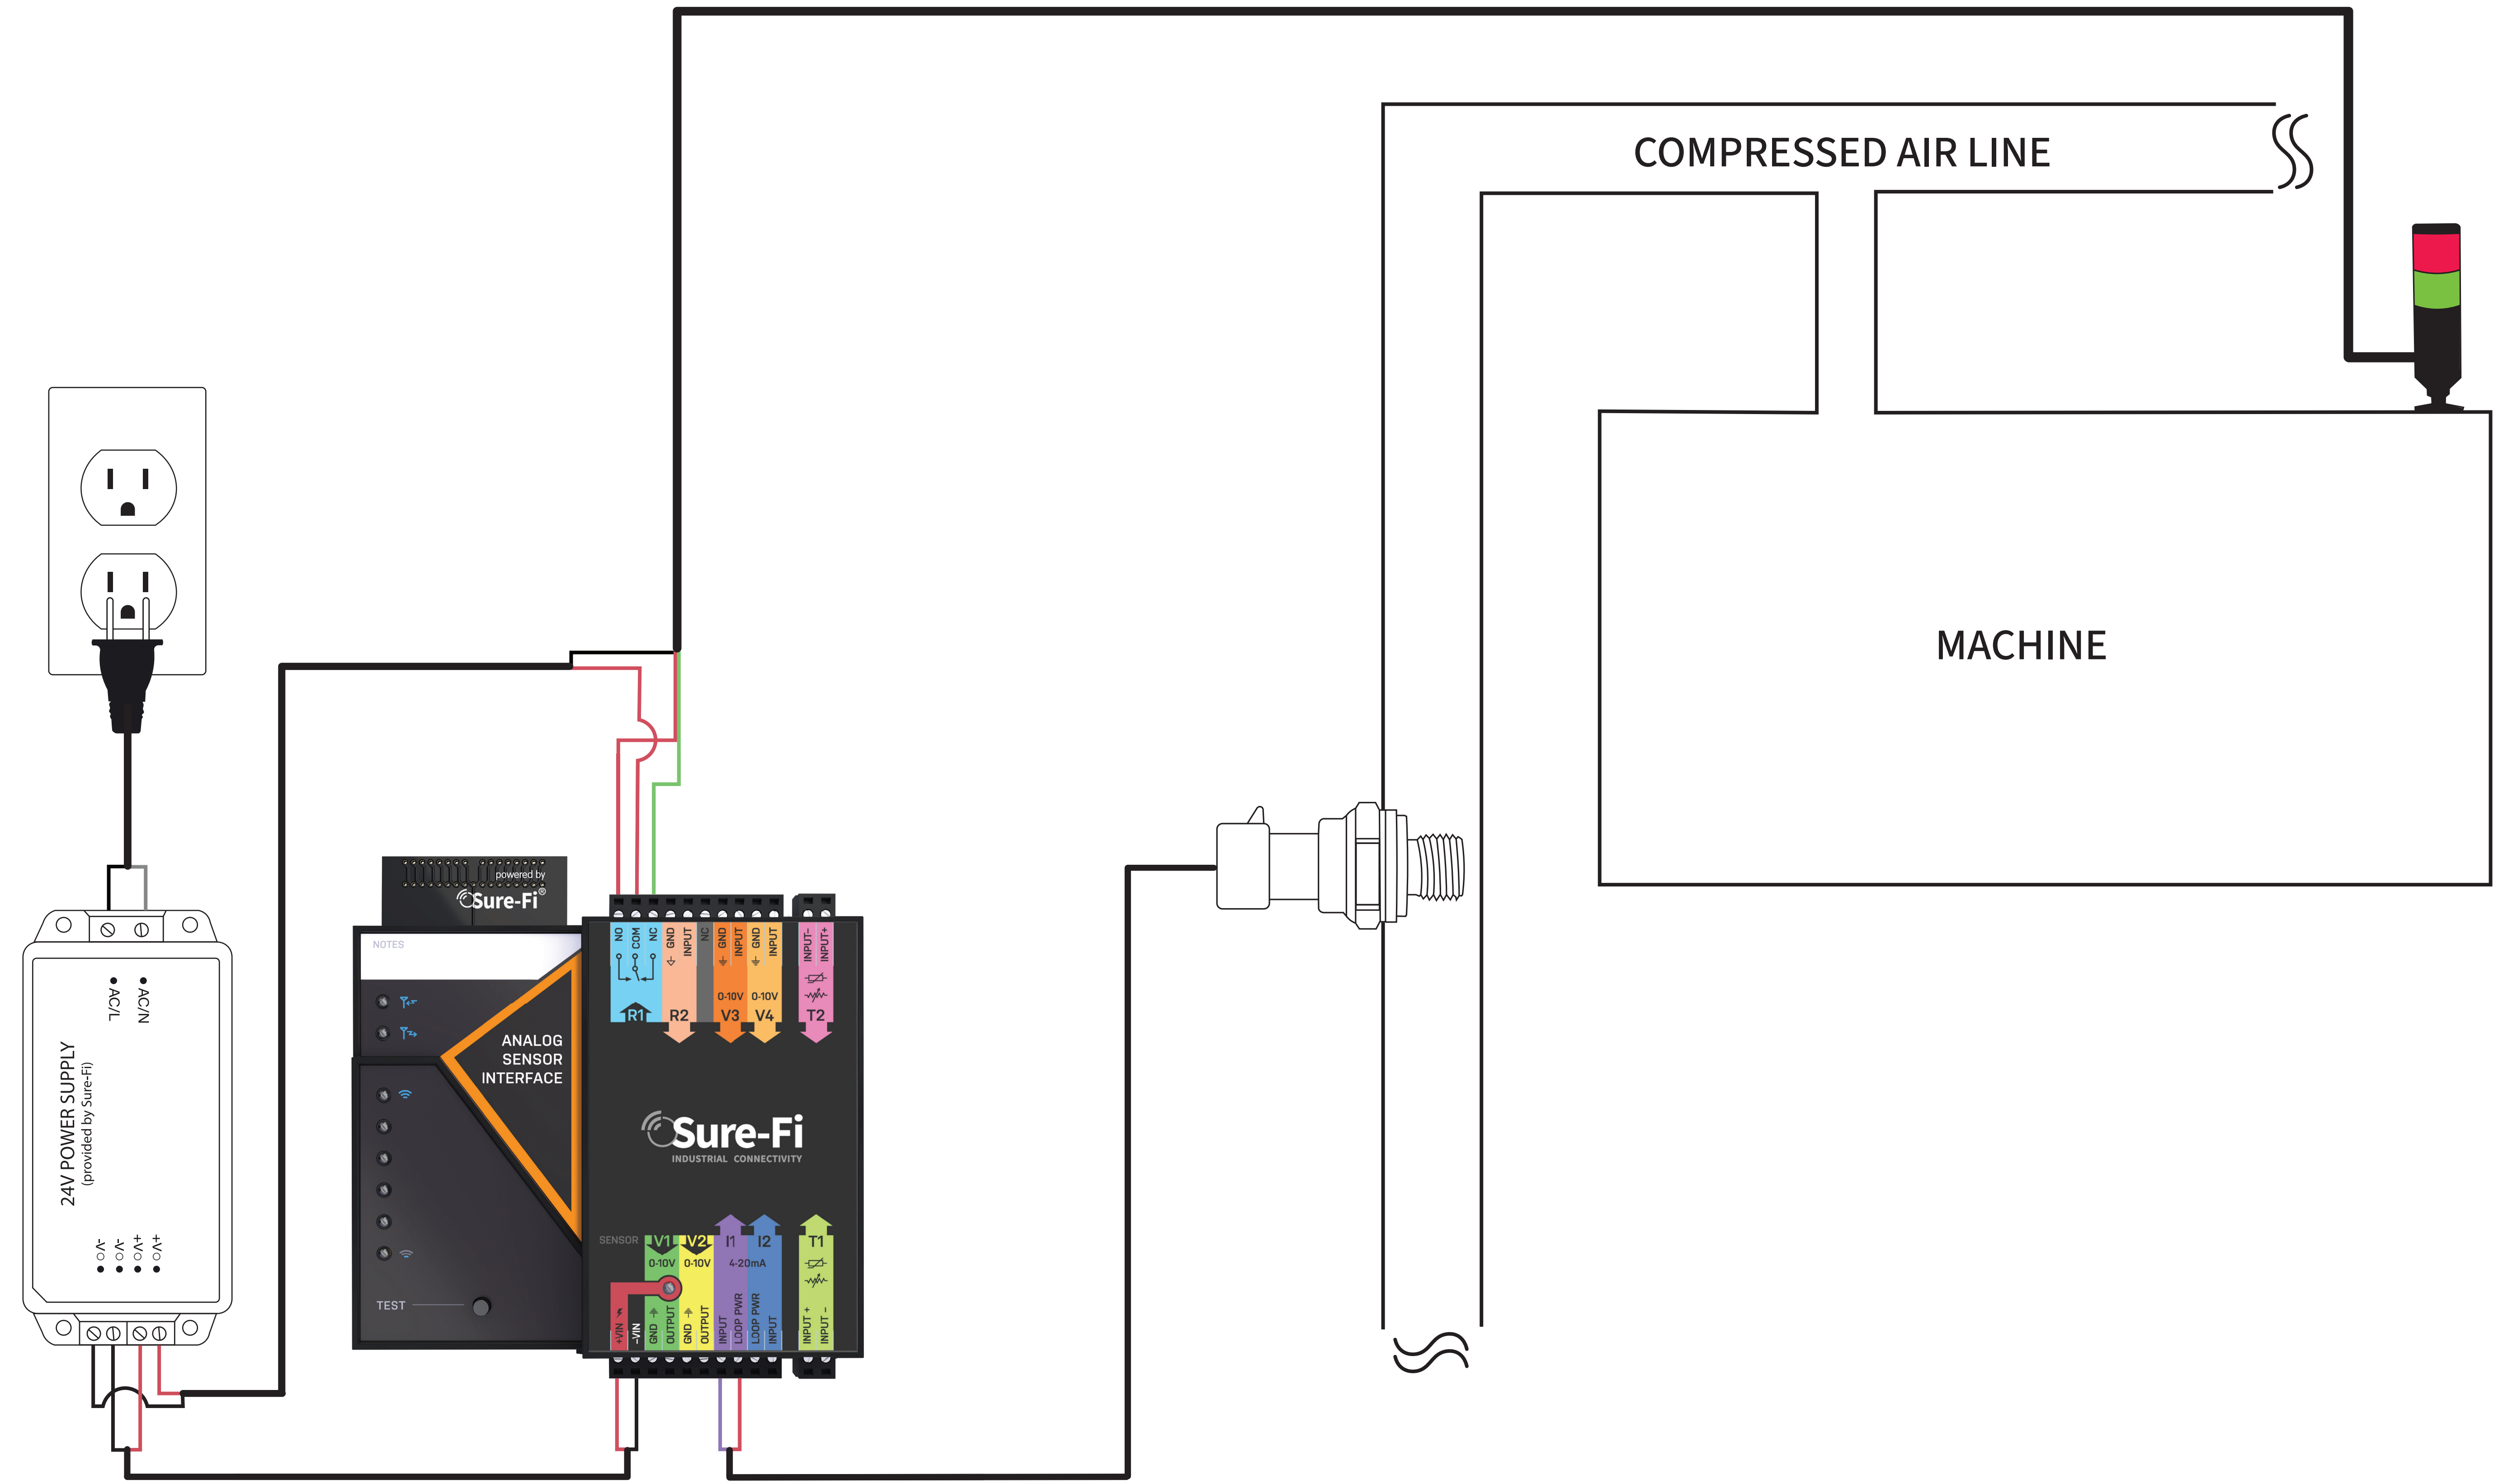


MANUFACTURING FLOOR

CONTROL ROOM

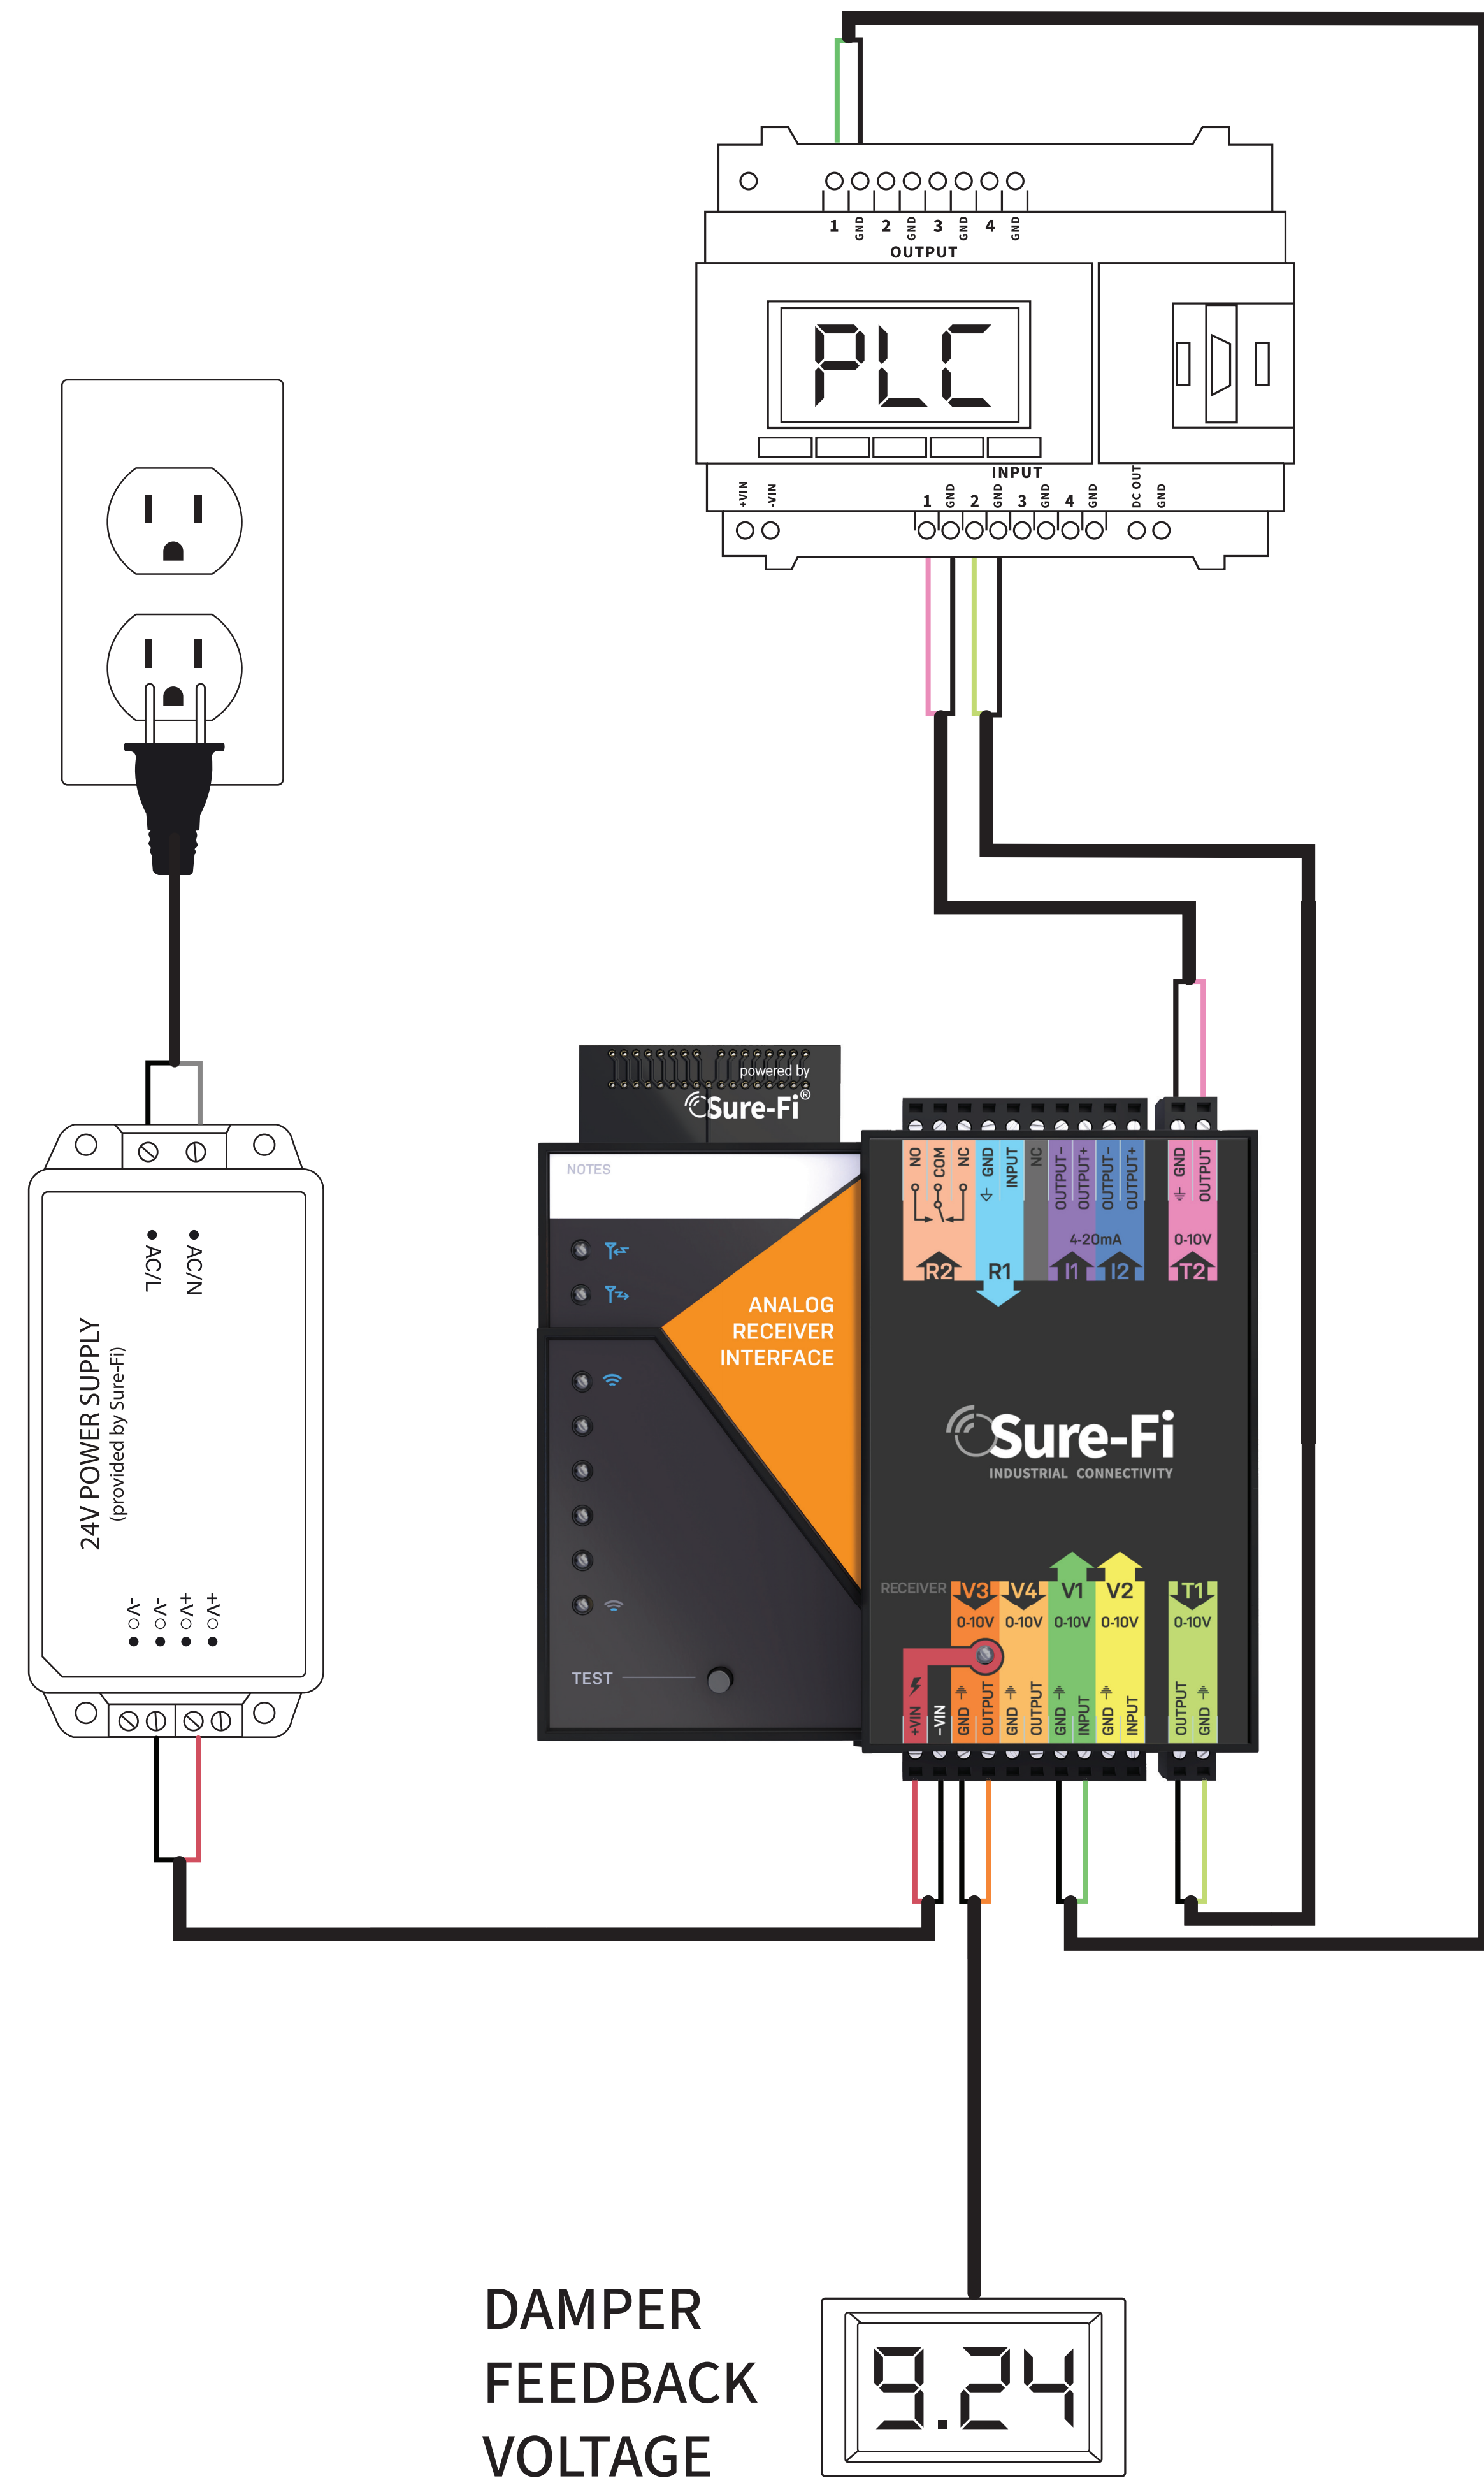

WIRING EXAMPLE FOR HVAC DAMPER 0-10V CONTROL

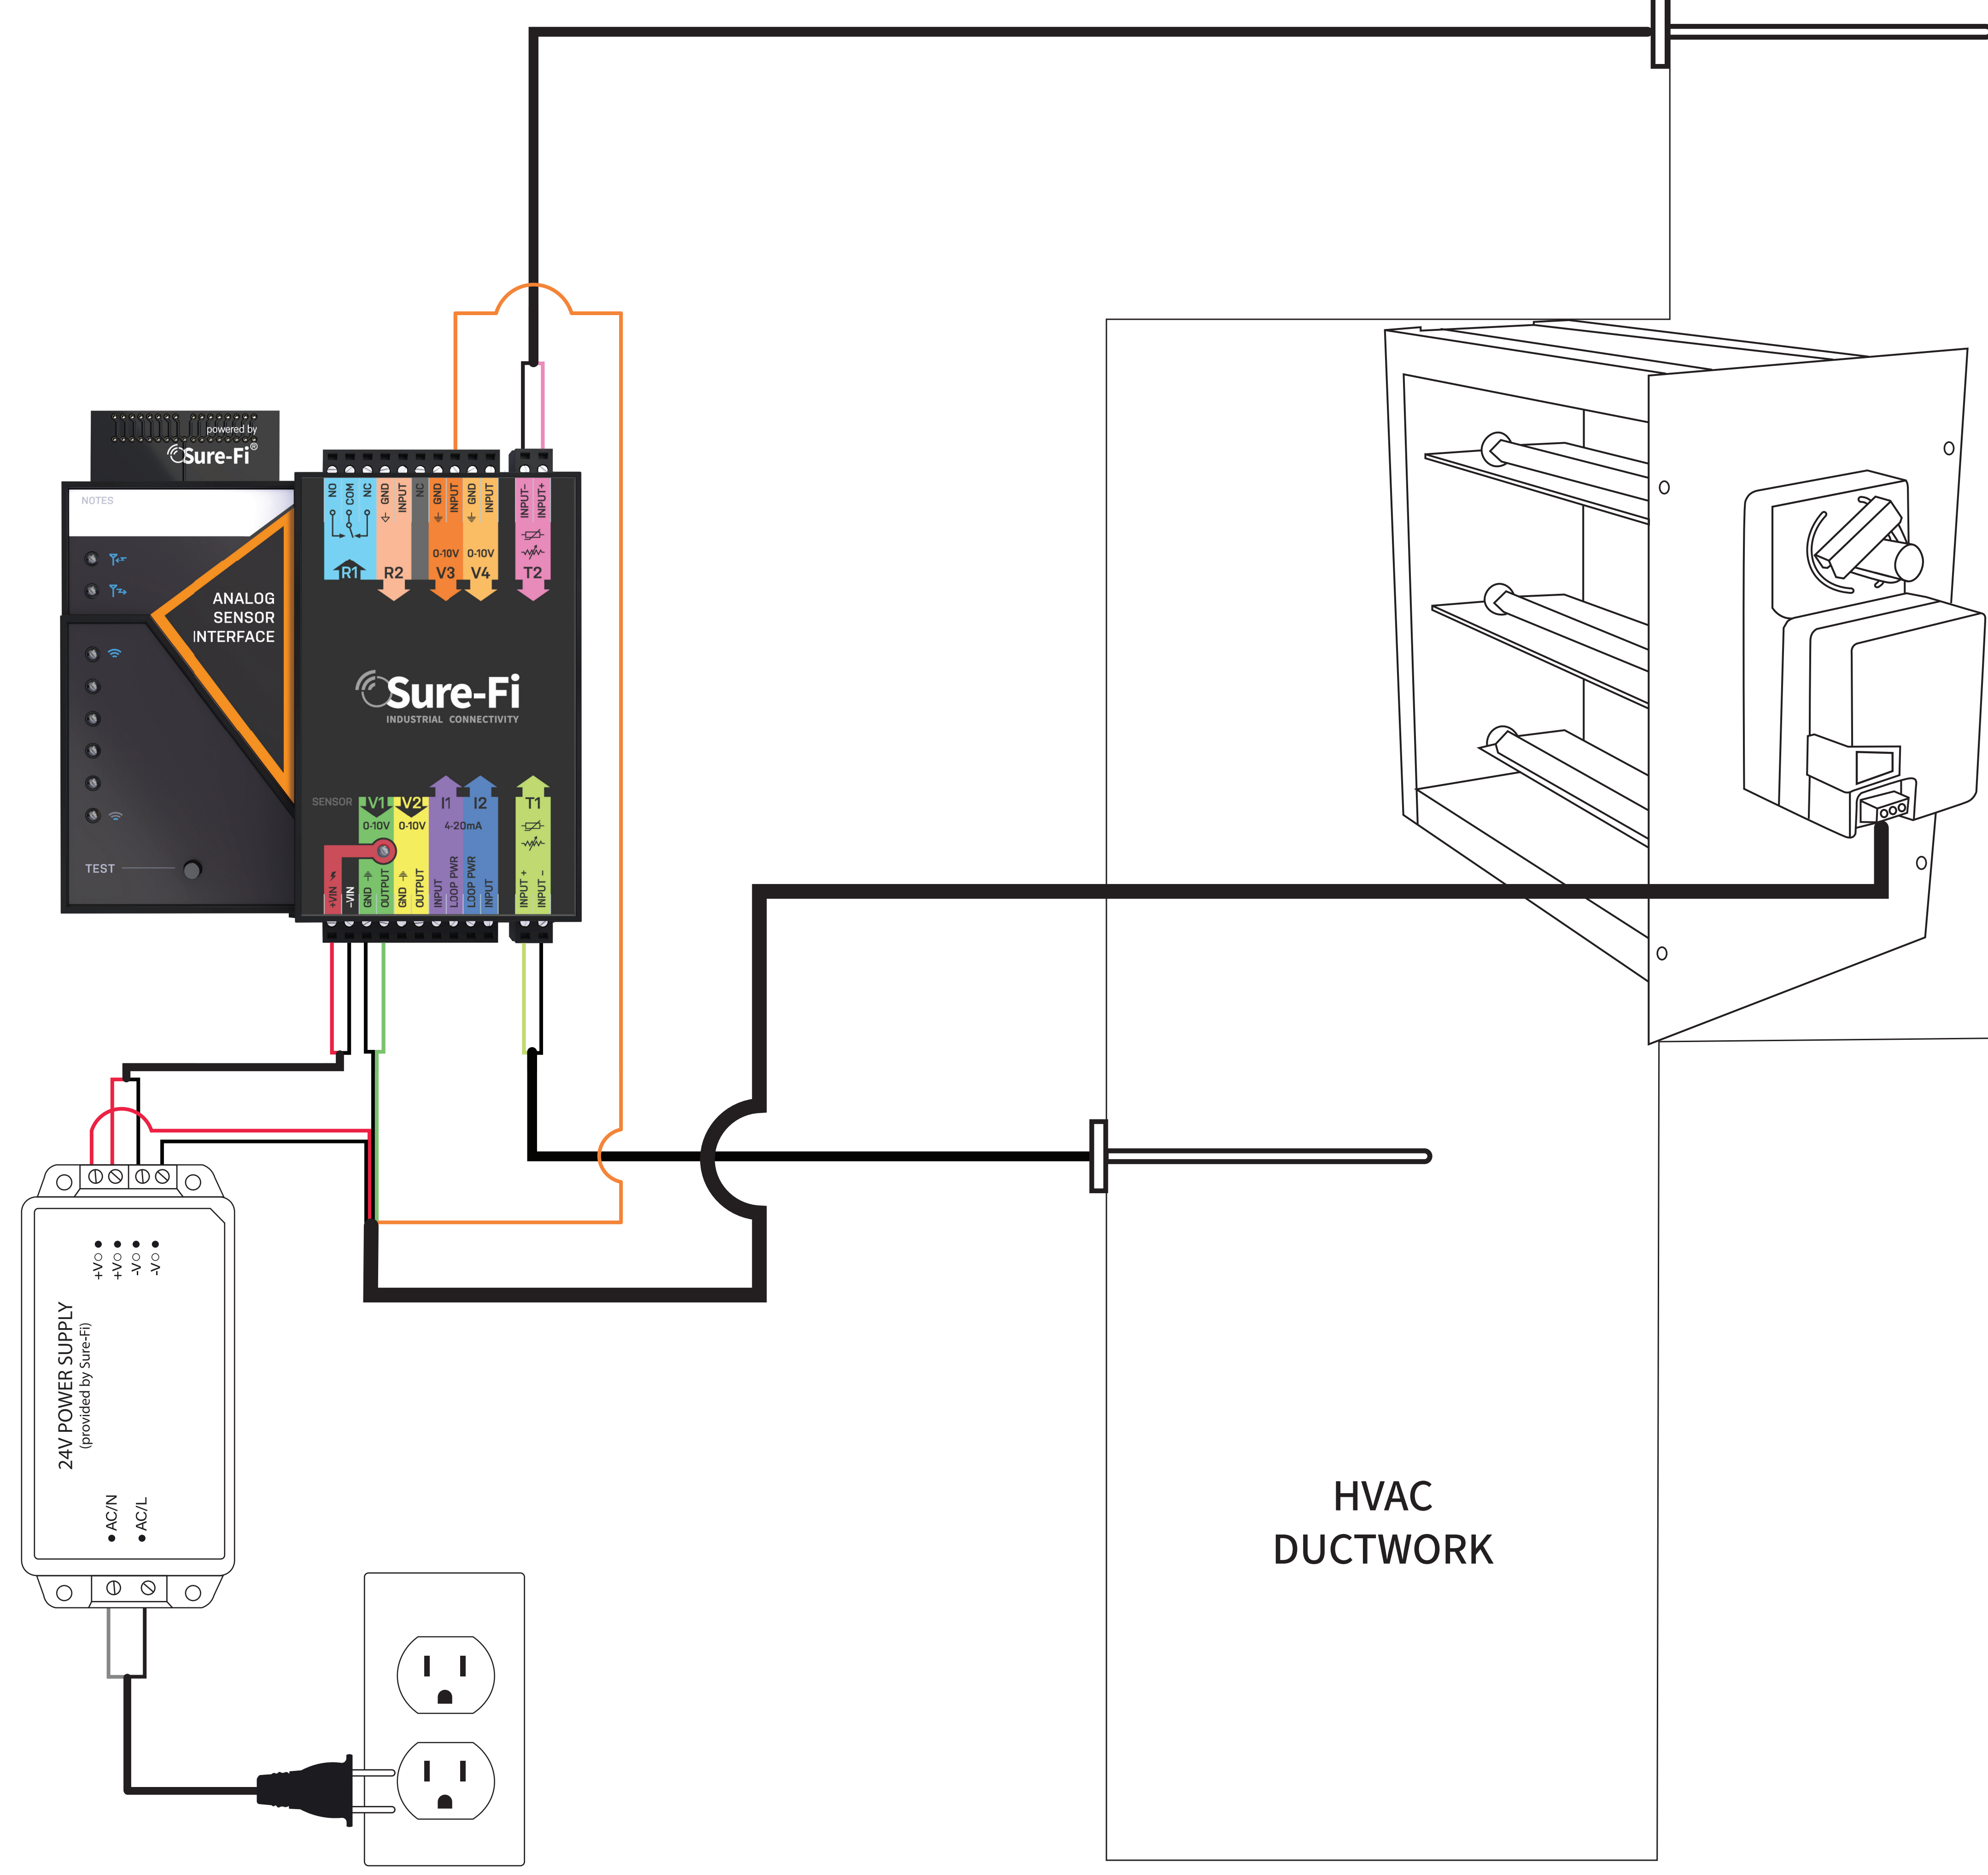



HVAC DUCTWORK

HVAC DUCTWORK

CONTROL ROOM

LEVEL ALARM
BASED ON
FLOAT INPUT

FLUID TEMPERATURE DISPLAY

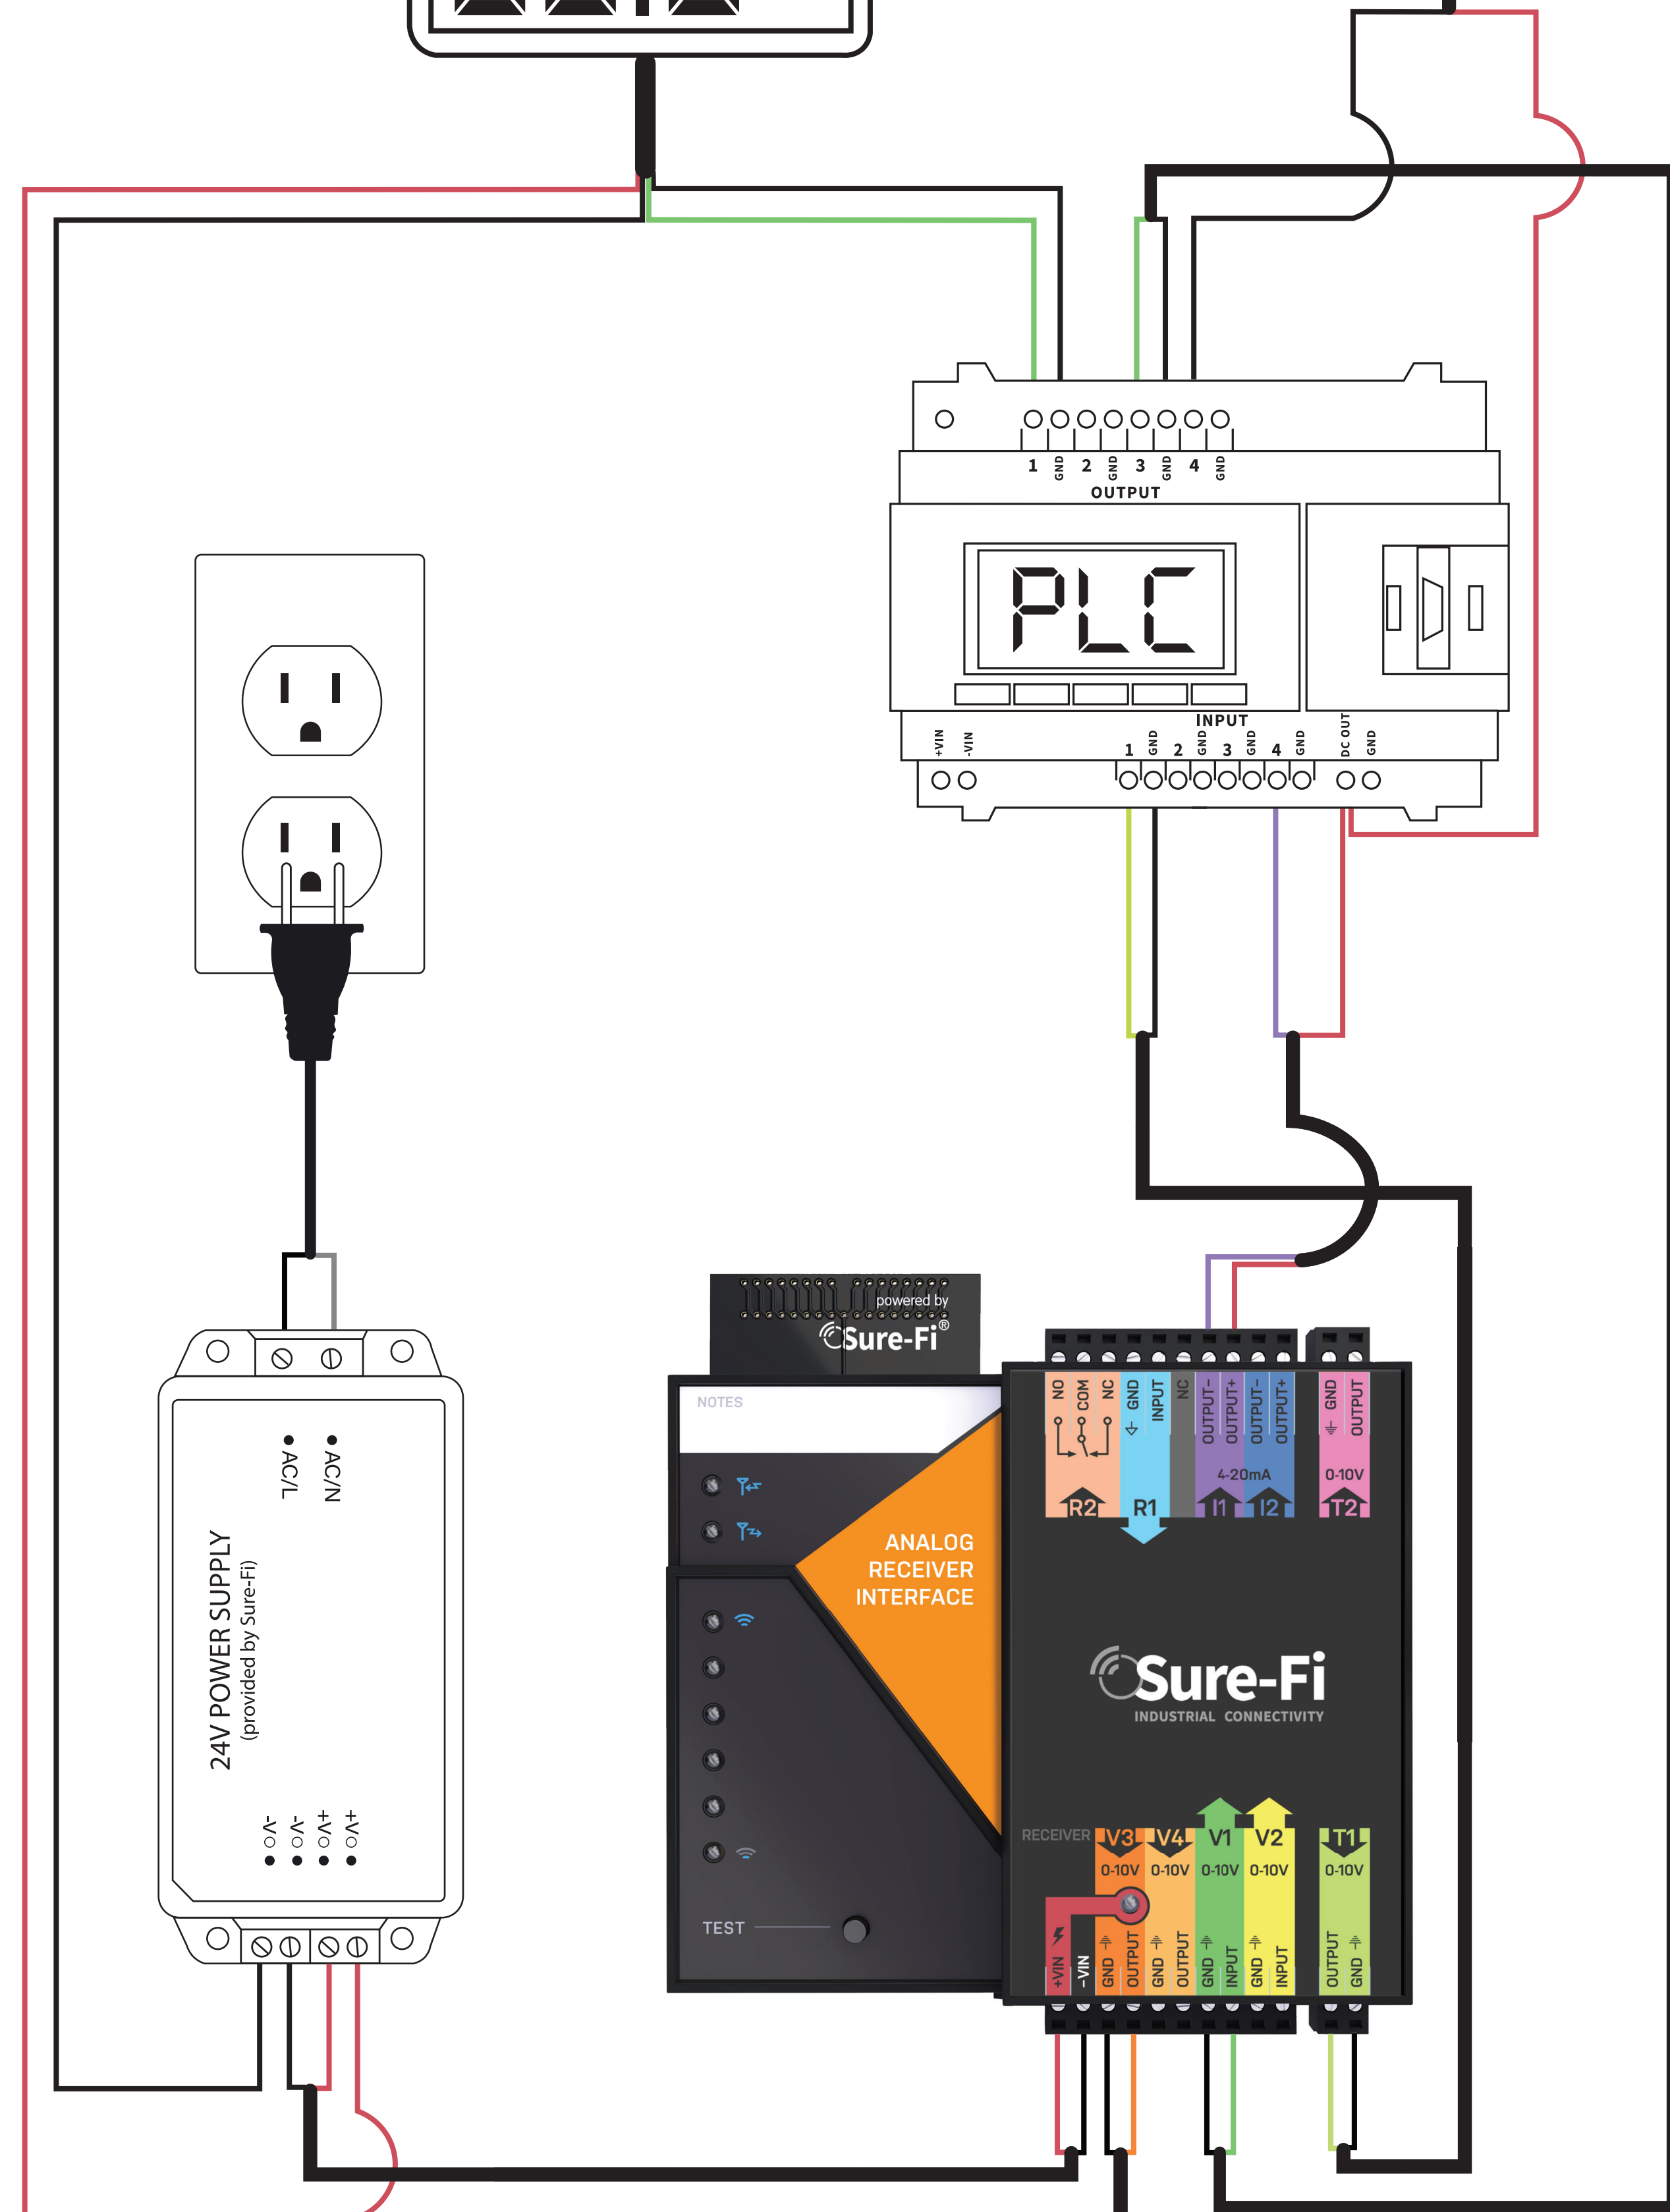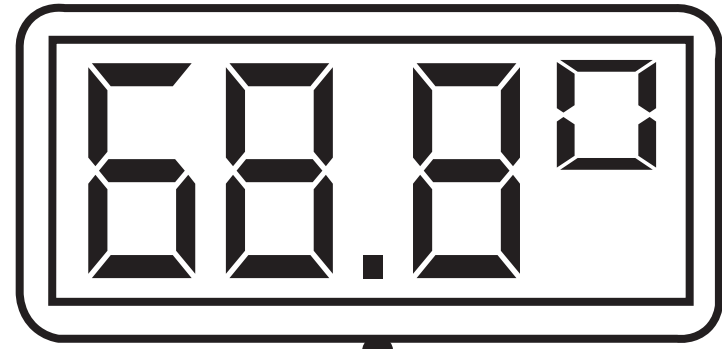

VALVE
FEEDBACK
VOLTAGE



WIRING EXAMPLE FOR TANK LEVEL CONTROL

