




Typical wiring for 4:1 LRAS remote trigger.

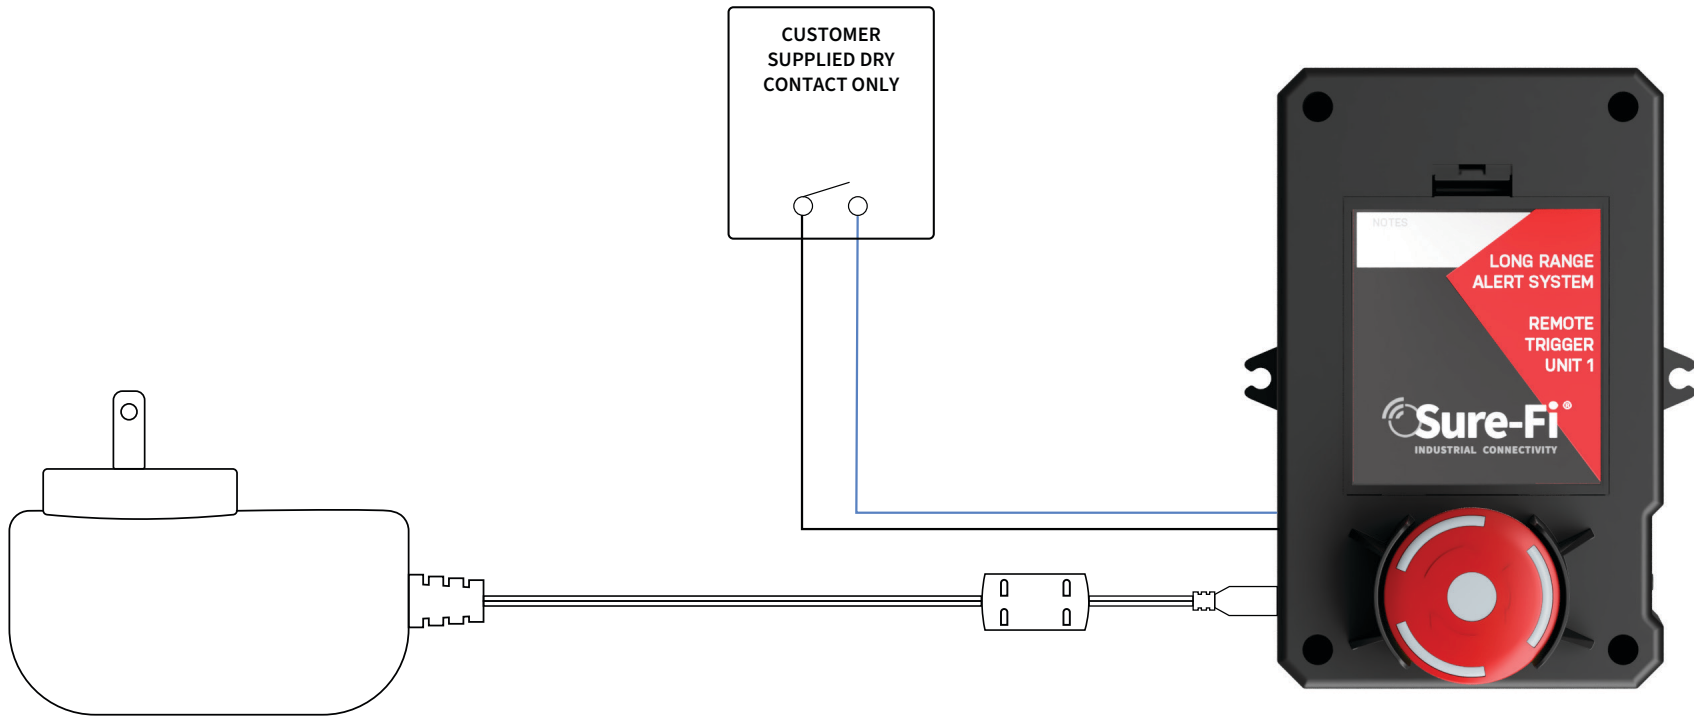


Typical wiring for 4:1 LRAS Hub using Sure-Fi supplied power supply and controller.

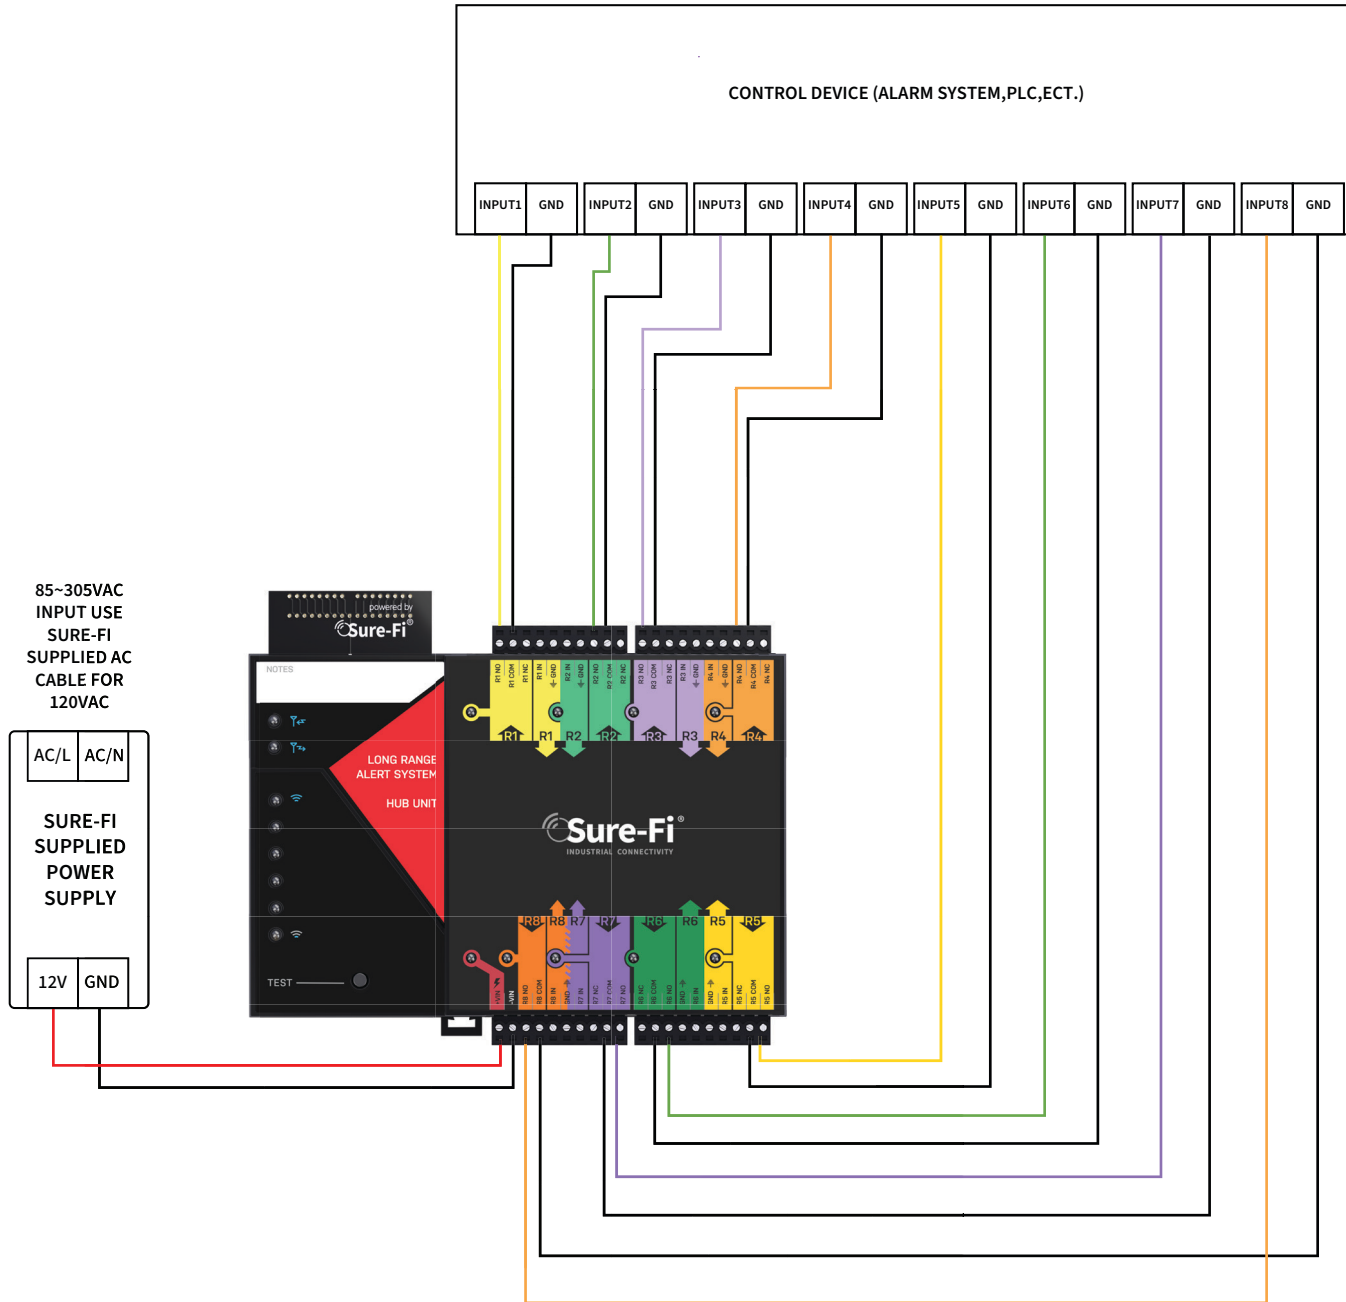

Typical wiring for 4:1 LRAS Hub using Sure-Fi supplied power supply and two alert devices rated $\leq 1A$ @ up to 24VDC

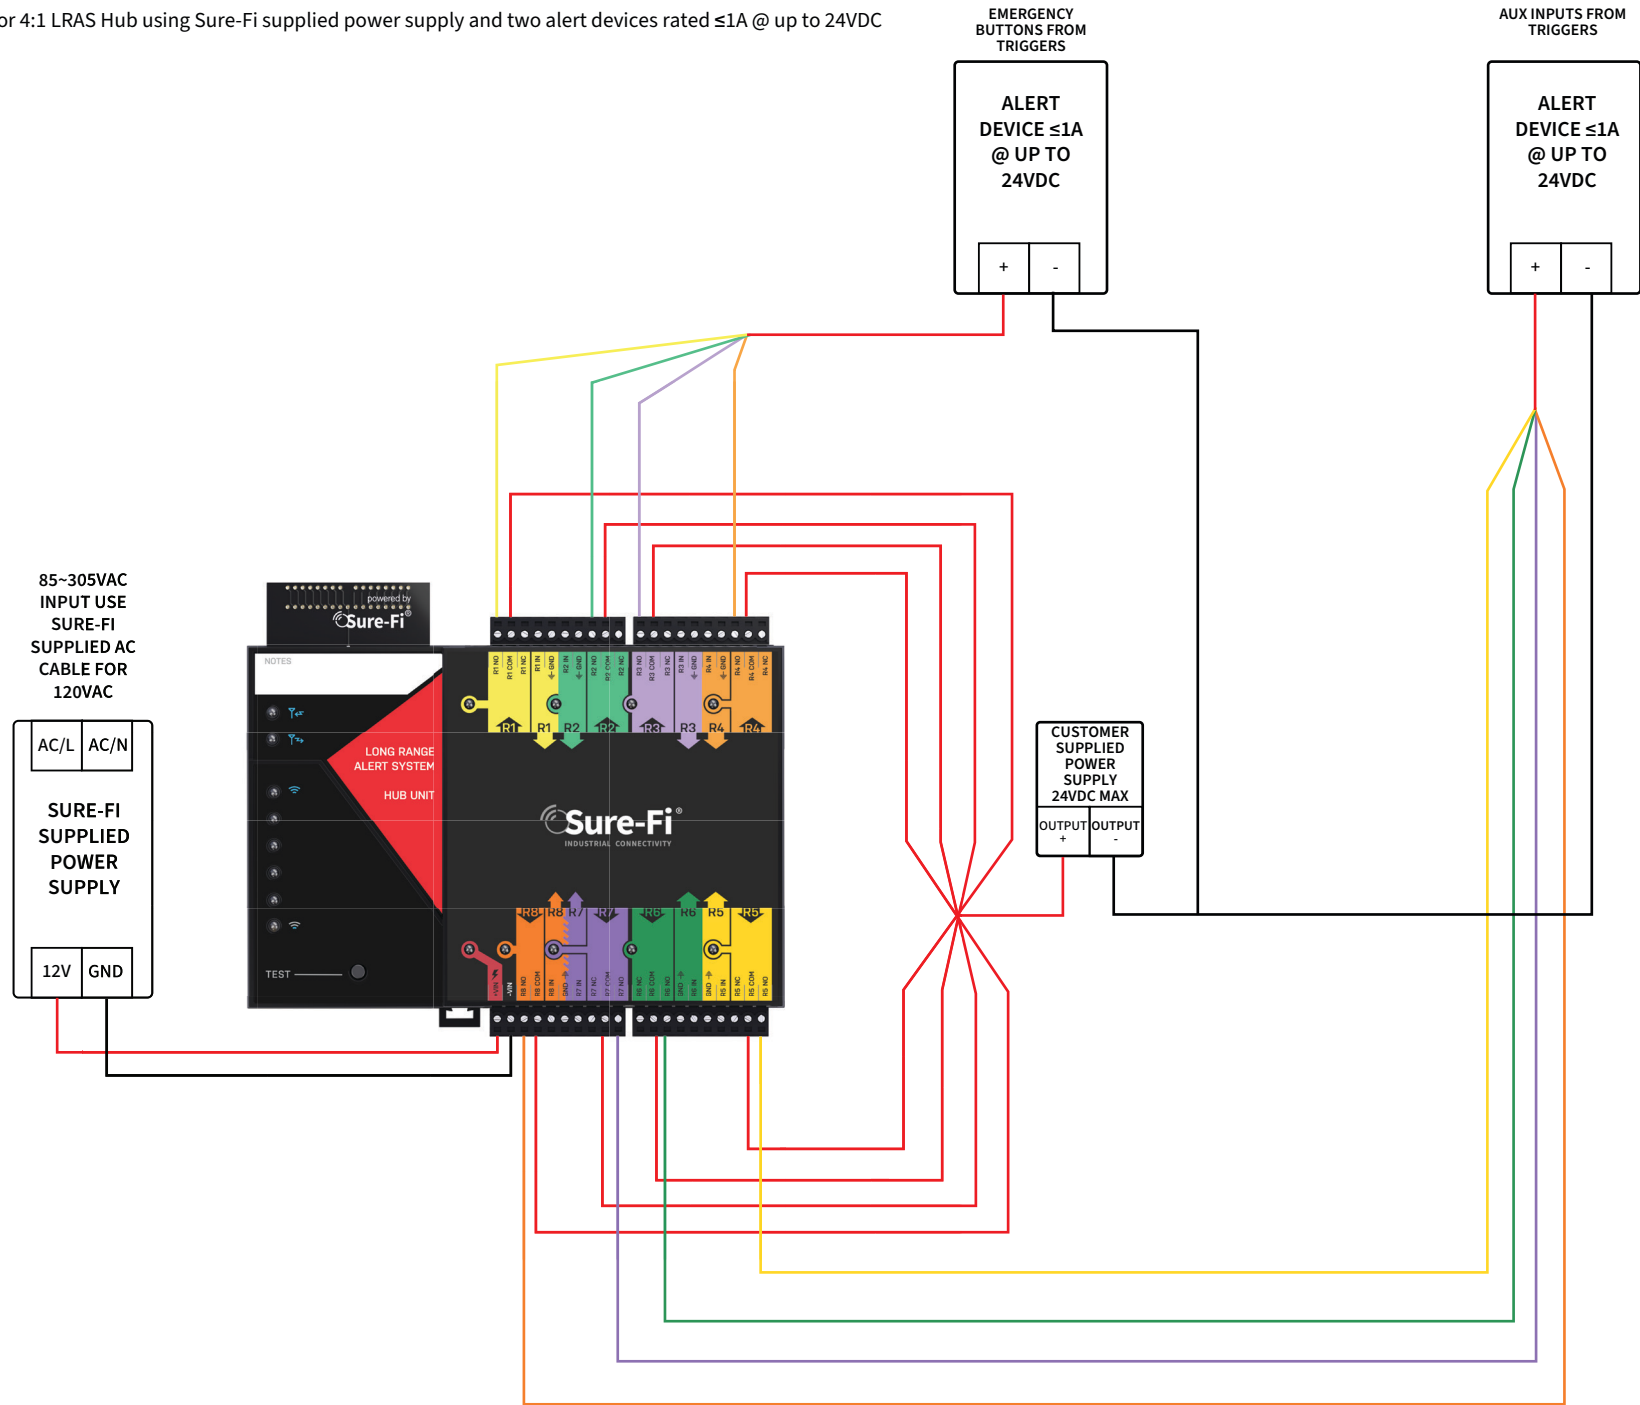

Typical wiring for 4:1 LRAS Hub using Sure-Fi supplied power supply and five alert devices rated $\leq 1A$ @ up to 24VDC

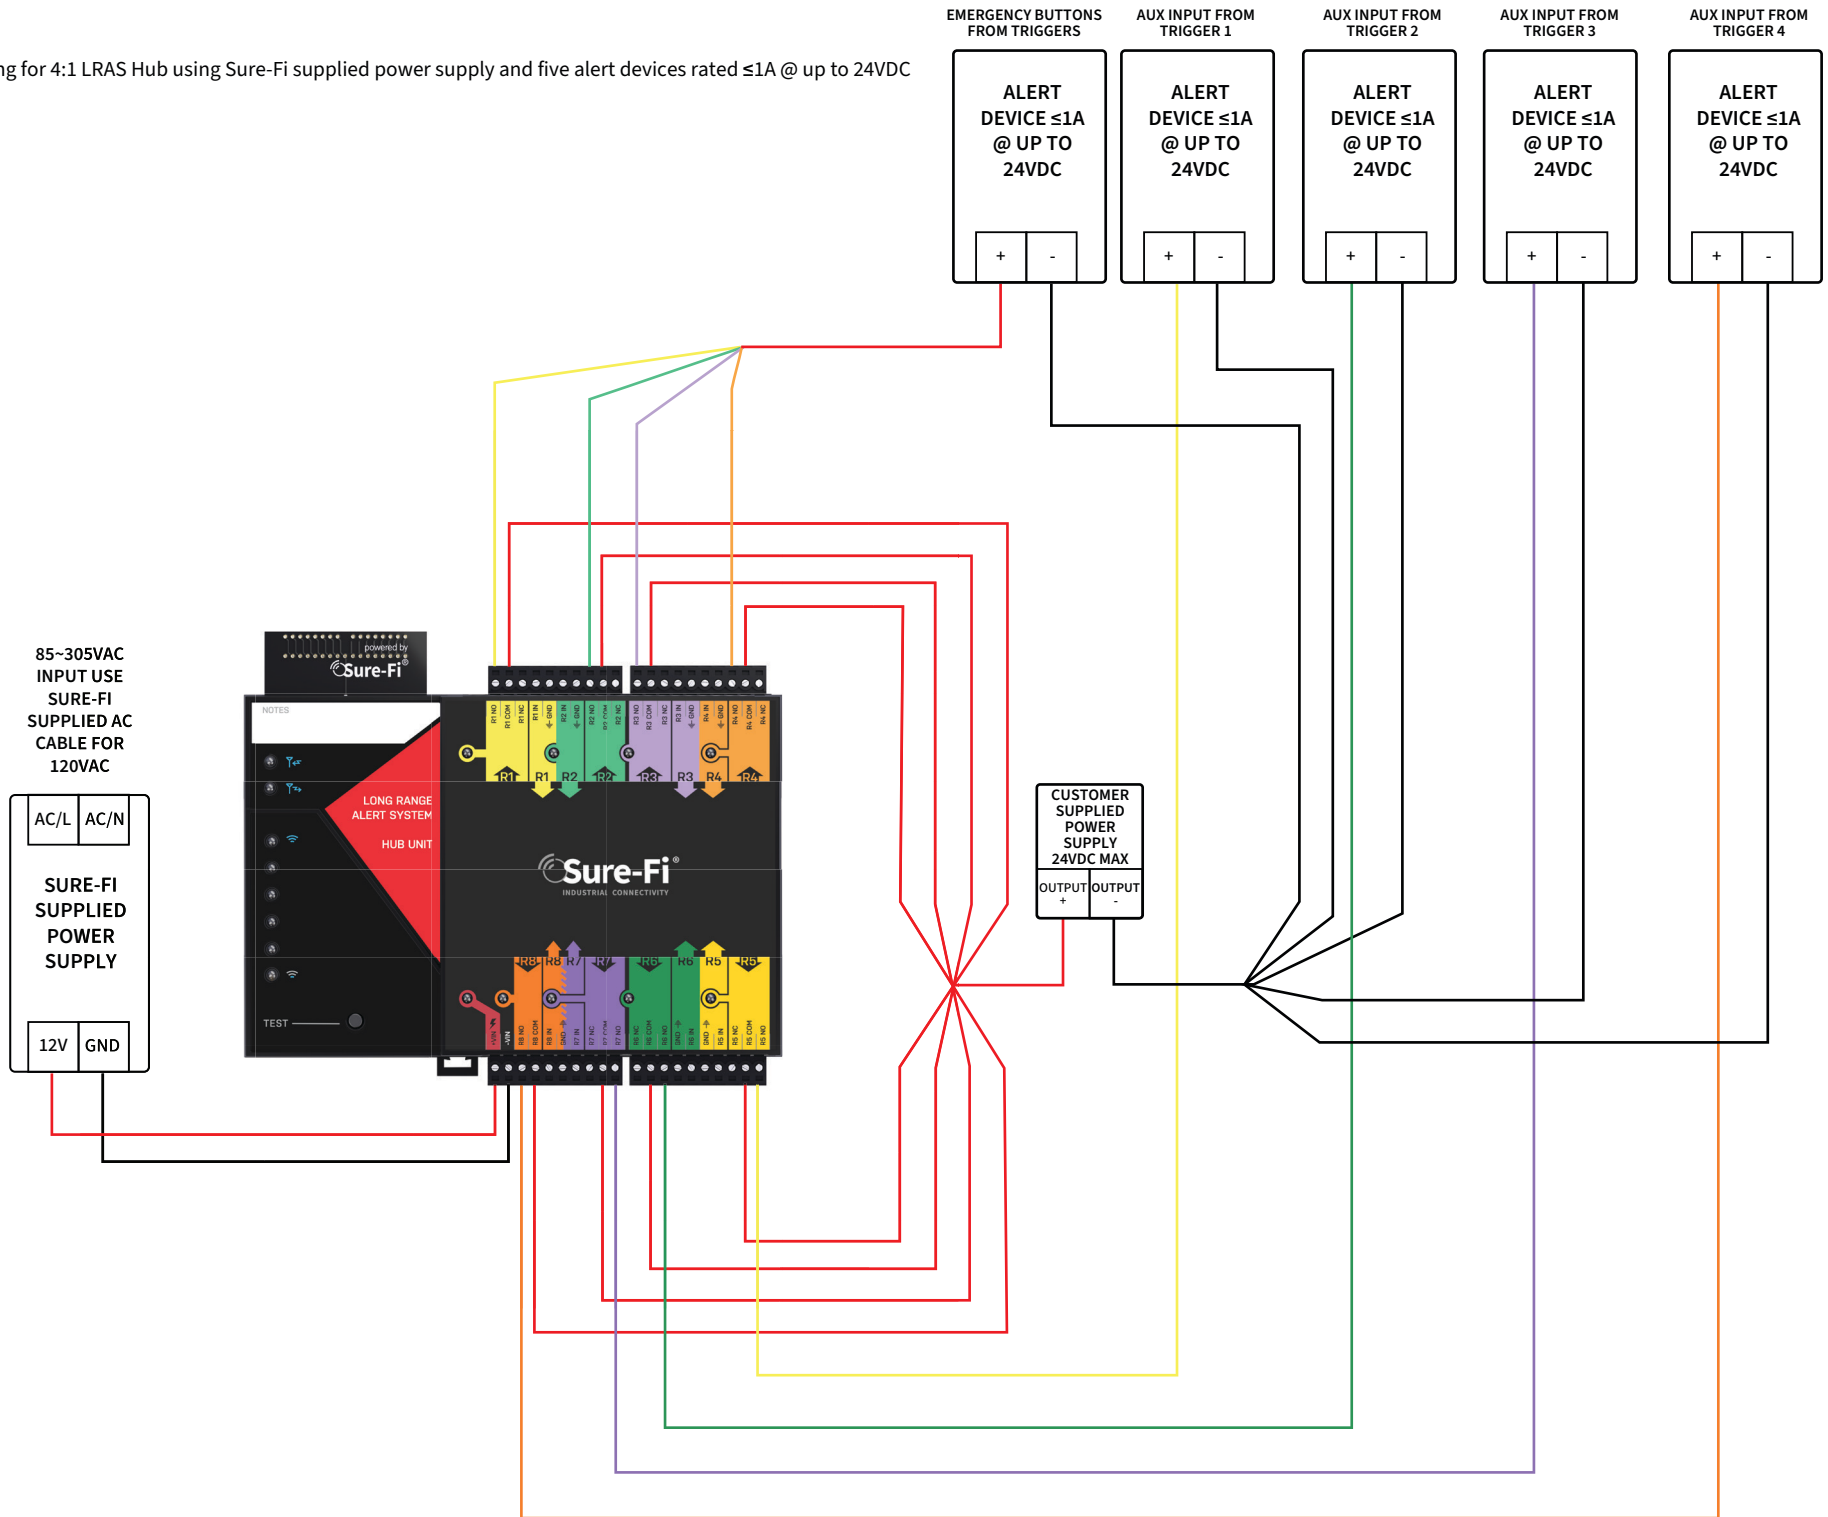

Typical wiring for 4:1 LRAS Hub using 24VAC power supply and controller.

